

检测报告

TEST REPORT

样品名称: 喷塑铜排
Sample Name: Sprayed copper row

委托单位: 杭州爵豪科技有限公司
Applicant: Hangzhou Juehao Technology Co., Ltd.

地址: 浙江省杭州市余杭区
Address: Yuhang District, Hangzhou City, Zhejiang Province

苏州联正测试技术服务有限公司
SuZhou Unifaith Testing Technical Service CO., LTD

2019-03-27

检测报告


TEST REPORT

样品名称 (Sample Name)		喷塑铜排 Sprayed copper row		样品材质 (Material)	铜 Copper
				检测类别 (Test Classification)	委托检验 Commissioned inspection
委托单位 (Client)	名称 (Name)	杭州爵豪科技有限公司 Hangzhou Juehao Technology Co., Ltd.		生产厂家 (Manufacturer)	/
	地址 (Add)	浙江省杭州市余杭区 Yuhang District, Hangzhou City, Zhejiang Province			
样品型号 (Sample Model)		/		样品数量 (Sample Quantity)	1 组
收样日期 (Rec. Date)		2019. 03. 08		完成日期 (Due. Date)	2019. 03. 27
样品描述 (Sample Description)		样品外观完好 The sample looks good			
试验设备 (Equipment)		精密烘箱/电子天平 Precision oven/Electronic balance			
检测结论 (Test Result)		试验结果符合要求 The test result meets the requirement			
偏离试验方法的说明 (Deviation Test Method)		/			
备注 (Note)					

编制: 
(Prepared By):

审核: 马记 
(Reviewed By):

批准: 
(Approved By):

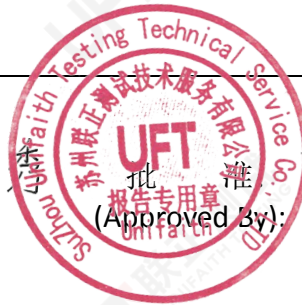

*****待续*****
***** Continued*****

检测报告

TEST REPORT

测试结果汇总表 Test result summary table					
序号 No	样品编号 Sample No	检测项目 Test items	检测依据 Test basis	检测结果 Test results	评判 Judge
1	LZTC-201903-011 -11 2#1-3	喷塑铜排 吸水性测试 Sprayed copper row Water absorption test	GB/T 1304-2008	详见第 5 页 See page 5	P
备注 Remarks					

“P”表示“试验结果符合要求”，“F”表示“试验结果不符合要求”，

"P" means "the test result meets the requirement", "F" means "the test result does not meet the requirement"

“N”表示“要求不适用于该产品”，“—”表示“试验结果不做评价”。

"N" means "the requirement does not apply to the product", "-" means "test results are not evaluated."

*****待续*****

***** Continued*****

检测报告

TEST REPORT

1. 测试项目: 喷塑铜排吸水性测试

Test items: Sprayed copper row Water absorption test

(1) 测试设备:

Test Equipment:

序号 No.	名称 Name	型号 Model	编号 Number	校准有效期 Calibration validity period
1	精密烘箱 Precision oven	AHL-1002A	LZ/S001	2020/01/18
2	电子天平 Electronic balance	HTP-312	LZ/B026	2019/12/03

(2) 实验室环境条件: 温度: 23.3℃, 湿度: 52%(RH)

Laboratory environmental conditions: Temperature: 23.3℃, humidity: 52% (RH)

(3) 参考标准: GB/T 1304-2008 塑料吸水性的测定

Reference standard: GB/T 1304-2008 Plastics-Determination of water absorption

- (4) 技术条件: ①将样品放入 50℃烘箱内干燥 24h, 然后在干燥器内冷却至室温, 称重样品重量;
②将试样放入盛有蒸馏水的容器中, 水温控制在 23℃;
③浸泡 24h 后, 取出试样, 用清洁干布擦去表面的水, 再次称量样品重量。

Temperature conditions: ①The sample was placed in a 50℃ oven for 24 h, then cooled to room temperature in a desiccator, and the weight of the sample was weighed;

②The sample is placed in a container containing distilled water, and the water temperature is controlled at 23℃;

③After soaking for 24 hours, take out the sample, wipe off the surface water with a clean dry cloth, and weigh the sample again.

(5) 检测要求: 吸水率小于 1%。

Testing requirements: The water absorption rate is less than 1%.


*****待续*****

***** Continued*****

(6) 检测结果: 如下
Test results: as follows

样品编号 Sample No.	实验结果 Experimental results			评判 judge
	烘箱后 (m ₁) After the oven	浸水后 (m ₂) After immersion	吸水率 Water absorption rate	
LZTC-201903-011-11 2#-1	10553.4mg	10554.1mg	0.007%	P
LZTC-201903-011-11 2#-2	10841.3mg	10842.4mg	0.01%	P
LZTC-201903-011-11 2#-3	11164.3mg	11168.4mg	0.04%	P
备注 Remarks	$\text{吸水率} = \frac{m_2 - m_1}{m_1} \times 100$			


(7) 测试图片:
Test picture:

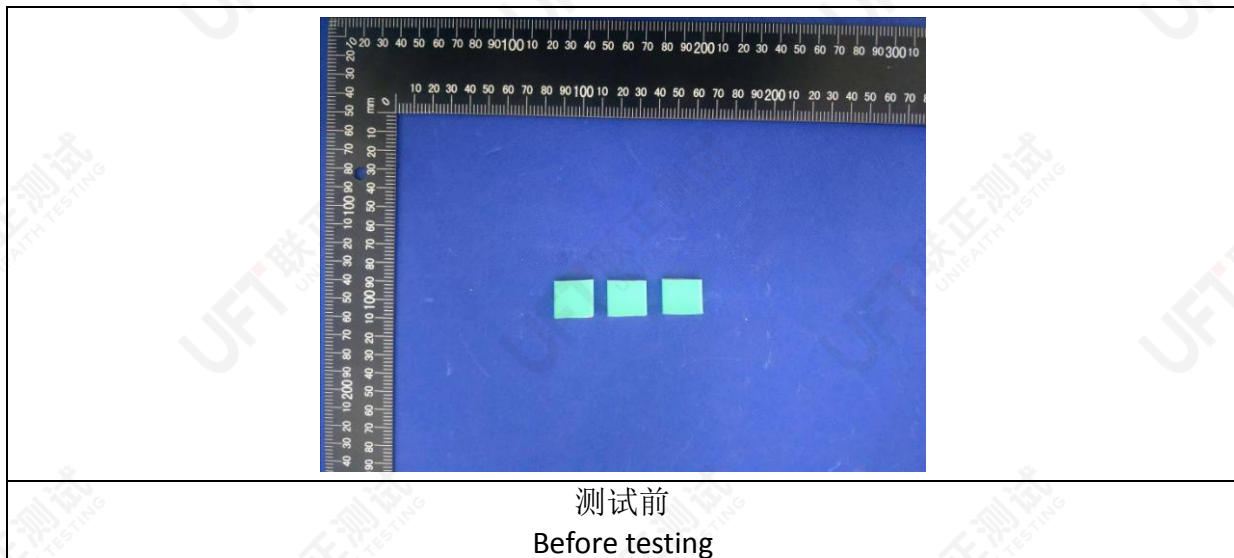

*****待续*****
***** Continued*****



测试中
Testing

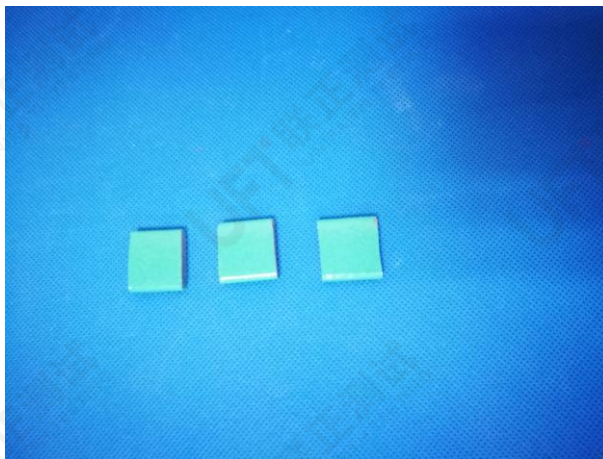

测试后
After testing

*****报告结束*****

***** End *****

注 意 事 项

Notice Items

1. 报告无本公司盖章无效, 电子版本报告仅供参考;

The test report is invalid without the official stamp of UFT; the electronic version of the report for your reference;

2. 未经本公司书面同意, 不得部分地复制本报告;

Any photocopies or part photocopies of the test report are forbidden without the written permission from UFT;

3. 报告无编制、审核、批准人签名无效;

The test report is invalid without the preparation of Approval and Reviewer;

4. 涂改、自行增删无效;

Alter, add or delete itself is invalid;

5. 对检验报告若有异议, 请于收到报告之日起十五天内向检验单位提出;

Objections to the test report must be submitted to UFT within 15 days;

6. 委托检验结果仅对所检验样品有效。

Commission test is responsible for the tested samples only.